


C.I.P.**375 FI. N.E. 2"1/2**

TAB. II

Datum 84-06-14

Revision 06-01-24

Ursprungsland: GB

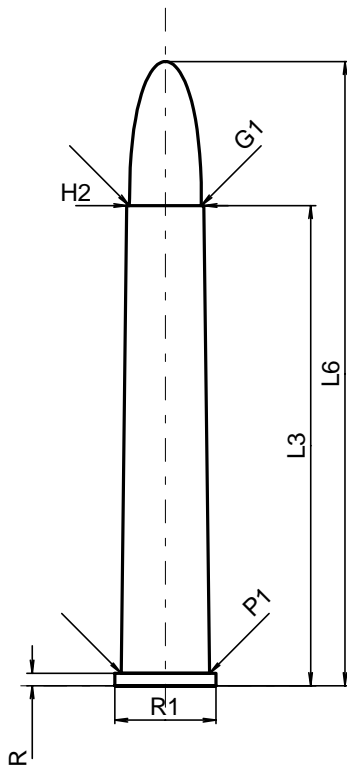**PATRONE MAXI****Längen**

L1	=	
L2	=	
L3 ¹⁾	=	63.50
L4	=	
L5	=	
L6	=	82.55

Hülsenboden

R ¹⁾	=	1.65	-0.25
R1	=	13.41	
R3	=		
E	=		
E1	=		
e min	=		
δ	=		
f	=		
β	=	45°	

Pulverkammer

P1	=	11.68
P2	=	

Schulterkonus

α	=	
S	=	
r1 min	=	
r2	=	

Hülsenhals

H1	=	
H2 ¹⁾	=	10.19

Geschoss

G1 ¹⁾	=	9.52
G2	=	
F	=	
L3+G ¹⁾	=	71.92

Drücke (Energien)**Mech. elektr. Wandler**

Pmax	=	2200 bar
PK	=	2530 bar
PE	=	2750 bar
M	=	25.00
EE	=	3220 Joule

Verschiedene Daten

Fe ¹⁾	=	0.15
delta L	=	

PATRONENLAGER MINI**Längen**

L1	=	
L2	=	
L3 ¹⁾	=	63.75

Stoßboden

R ¹⁾	=	1.65
R1	=	13.67
R2	=	
R3	=	
r	=	

Pulverkammer

E	=	
P1 ¹⁾	=	11.68
P2	=	

Schulterkonus

α	=	
S	=	
r1 max	=	
r2	=	

Hülsenhals

H1	=	
H2 ¹⁾	=	10.21

Geschossübergang


G1 ^{1)*}	=	9.58
G ^{1)*}	=	8.42
α1	=	90°
h*	=	0.32
s	=	
i ¹⁾	=	1°10'
w	=	

Lauf

F ^{1)*}	=	9.25
Z ¹⁾	=	9.50

Züge

b	=	2.92
N	=	6
u	=	475.00
Q	=	67.20 mm ²

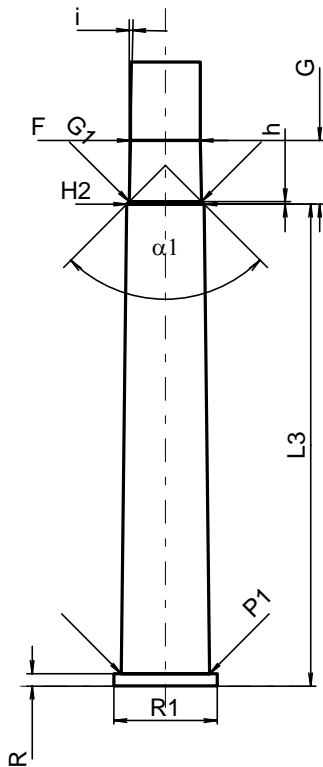

Maßstab 1:1

Maße in << mm >>
Maße und Toleranzen für Messläufe
siehe Anhang CR 1.

Bemerkungen: 1) Kontrolle aus Sicherheitsgründen
* Grundmaße